


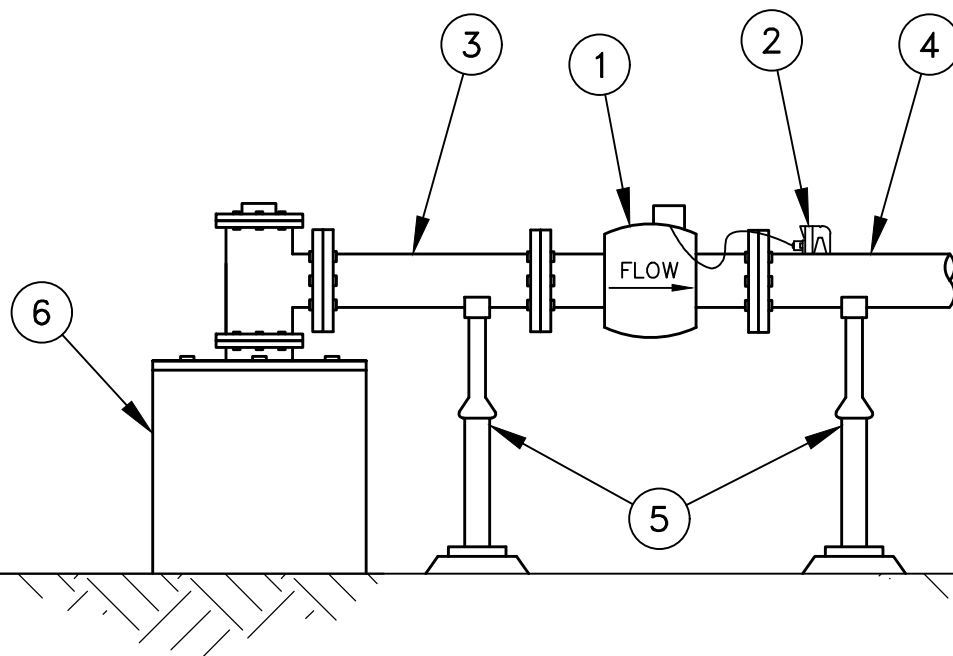

ITEM	DESCRIPTION
------	-------------

- | | |
|---|--|
| 1 | APPROVED AMI-COMPATIBLE METER INSTALLED PER MANUFACTURER'S SPECIFICATIONS WITH 3-WIRE ENCODED OUTPUT OR PULSE OUTPUT COMPATIBLE WITH BADGER ORION ENDPOINTS. PROPERTY OF WELL OWNER. |
| 2 | CGSA INSTALLED, OWNED AND MAINTAINED AMI ENDPOINT. |
| 3 | ADEQUATE LENGTH OF CLEAN UPSTREAM PIPE, PER MANUFACTURER'S SPECIFICATIONS. NO TEES, VALVES, OUTLETS, OR HOSE BIBS BETWEEN WATER METER AND WELL HEAD. |
| 4 | ADEQUATE LENGTH OF CLEAN DOWNSTREAM PIPE, PER MANUFACTURER'S SPECIFICATIONS. NO TEES, VALVES, OUTLETS, OR FITTINGS WITHIN PIPE LENGTH SPECIFIED BY MANUFACTURER. |
| 5 | PIPE STANDS (OPTIONAL). |
| 6 | WELL HEAD. |

GENERAL NOTES

- ALL INSTALLATIONS SHALL MEET CALIFORNIA CODE OF REGULATIONS TIT. 3, § 6610 – BACKFLOW PREVENTION (PESTICIDE REGULATIONS). THIS NOTE APPLIES TO AGRICULTURAL WELLS THAT USE OR PLAN TO USE CHEMIGATION OR FERTIGATION.
- ALL INSTALLATIONS SHALL MEET THE WELLHEAD REQUIREMENTS OF THE IRRIGATED LANDS PROGRAM.
- ALL INSTALLATIONS SHALL COMPLY WITH CALIFORNIA WELL STANDARDS, DWR BULLETIN 74-90.
- ALL WELL INSTALLATIONS SHALL MEET THE REQUIREMENTS OF CHAPTER 34A OF THE SANTA BARBARA COUNTY MUNICIPAL CODE.
- PLACEMENT OF BACKFLOW DEVICES, WHEN NEEDED, SHALL BE INSTALLED DOWNSTREAM OF THE METER.
- METER SHALL BE INSTALLED IN COMPLIANCE WITH MANUFACTURER'S REQUIREMENTS.

CARPINTERIA VALLEY WATER DISTRICT			PRIVATE WELL METERING		STANDARD DETAIL NO. W-123	
REV.	DATE	BY				DRAWN BY: SS
UPDATE	3/5/26	SS			SCALE: NONE DATE: 06/17/2025	
					APPROVED BY: _____ DISTRICT ENGINEER	
					SHT 1 OF 1	